The following changes in the tender documents are effective immediately. This addendum will form part of the contract documents.

Addendum 2:

Addendum No. 2 Cover Page (1 page)

WMTA Addendum No. 2 dated March 11, 2026 (8 pages)

Revised Attachment 2 – IFT Architectural Drawings A05 – A06 issued for Addendum No. 2 dated March 10, 2026 (2 pages)

ACM Update 2023 Leeds (102 pages)

Revised Appendix 5 – Rate Bid Form

This Addendum is issued prior to receipt of Bids to provide clarifications, and make revisions, to the Drawings and Specifications. The most recent Addendum governs over previous Addenda.

CLOSING DATE FOR THIS RFT HAS BEEN EXTENDED.

See Appendix 1 – RFT Data Sheet and its Attachments, Section 4 – Timetable

DELETE: Submission Deadline March 17, 2026 at 3:00pm EST
REPLACE WITH: Submission Deadline March 19, 2026 at 3:00pm EST

Questions and Answers

Question 4: Who is responsible for paying FA bypass?

Answer: Carleton University is responsible for the FA bypass. GC to provide hot work permit for FA bypass to Carleton Project Manager.

FA bypass and hot work to be completed during normal working hours Monday to Friday, 6am – 4pm.

Question 5: Is this a public tender or qualified GC's only?

Answer: This is a public tender.

Question 6: Do we need to grind existing flooring? Please confirm.

Answer: Yes, grinding of the existing floor will be required for all new flooring finishes.

FLOORING PREPARATION

.1 Floor must be free of all dust, loose particles, solvents, paint, grease, oil, wax, alkali, sealing/curing and parting compounds, old adhesive, and any other foreign material, which could affect the installation and adhesive bond to the substrate. All substrate contaminants must be mechanically removed prior to the installation of the flooring.
DO NOT use liquid solvents or adhesive removers
DO NOT use oil-based sweeping compounds

.2 Remove sub-floor ridges and bumps. Fill low spots, cracks, joints, holes and other defects with sub-floor filler. Clean floor and apply filler; trowel and float to leave smooth, flat hard surface. Prohibit traffic until filler cured and dry. Refer to cash allowance.

Question 7: Would you please clarify Section 2 – Base Bid
1) Are the allowances included in the Base Bid?
2) What do we type in for price under Cash Allowances # 1 and # 2? The price is already provided under the description.

Answer: Yes, cash allowances to be included in the Base Bid. Please type/print the stated price in the blank space for acknowledgement.

Question 8: Please confirm the following items:
1) We will have access to the elevator.

2) We will be provided with a designated area outside for waste containers.
3) Is free parking available during the summer months?

Answer: GC will have access to 2 elevators. Refer to Addendum Item 1.5 on cleaning of elevators.
One free parking space will be provided, and additional vehicles will be required to use paid parking spaces.

Designated area for waste containers identified in Google Map below.



Question 9: Please see Appendix 3, See Supplementary Conditions. See Article A-5.1. Please clarify where "10%" should be added within this provision.

Answer: Please delete the reference to "10%" in Article A-5.1, as it is not applicable.

Question 10: Please see Appendix 3, See Supplementary Conditions. See Article A-5.3. a. With respect to item .1, we request the following be added at the end: "as required and in accordance with this Contract." b. Items .2, .3, .4, and .10 should be conditioned on the Owner not being in default of its payment obligations to the Contractor. If the Owner is in default, then it should not also have a right to withhold further payment as a result of liens, legal action, etc. c. Item .6 should be deleted. The work under the contract is covered by the Contractor's bid price; any additional work would be by change order or change directive, and there are provisions within the contract that address same, including the pricing of same. d. We request the deletion of item .8. There are already provisions within the contract that address delays, and breaches of contract, and the procedures which must be followed regarding same.

Answer:
a. The wording of item .1 will remain unchanged.

b. The wording of items .2, .3, .4, and .10 will remain unchanged.
c. The removal of item .6 is accepted.
d. The removal of item .8 is accepted.

Question 11: Please see Appendix 3, See Supplementary Conditions. See Article A-9. We request that this provision we amended to note that the Contractor may destroy documentation as reasonably permitted by law and/or following the expiry of seven (7) years after substantial performance. Under the current wording, the Contractor is required to maintain the documents in perpetuity unless the Owner consents to some other timeline. We believe the Contractor should be permitted to destroy documents in its normal course of business, and after applicable legal timelines have expired.

Answer: The current wording of Article A-9 will remain unchanged at this time.

Question 12: Please see Appendix 3, See Supplementary Conditions. See GC 2.2.12. Please revise 7 working days to 10 working days to allow the Contractor and Subcontractors ample time to review the instruction.

Answer: The timeframe in GC 2.2.12 will remain unchanged at 7 working days.

Question 13: Please see Appendix 3, See Supplementary Conditions. See GC 3.6.2. We request that this section be revised to note that, if the Owner rejects a subcontractor or supplier, and requires the use by a Contractor of a higher-priced subcontractor / supplier, and if this is only indicated following the bid closing, then the Owner be required to pay the difference in price, if same results in an increased price.

Answer: The wording of GC 3.6.2 will remain unchanged

Question 14: Please see Appendix 3, See Supplementary Conditions. See GC 5.2.1. We request that submission of an application for payment be permitted on a range of dates (for instance, anytime between the 25th and the 28th of each month).

Answer: The requested revision to GC 5.2.1 is accepted. An application for payment may be submitted between the 25th and 28th of each month.

Question 15: Please see Appendix 3, See Supplementary Conditions. See GC 5.2.2. With respect to the item that requires the Contractor to detail any delay which may impact the schedule, we request that this be conditioned on the Contractor being aware of such event, and that a condition be added which notes that nothing in this section is meant to restrict the Contractor's ability to claim for a delay under the applicable provisions of this Contract (i.e. 6.5).

Answer: The wording of GC 5.2.2 will remain unchanged.

Question 16: Please see Appendix 3, See Supplementary Conditions. See GC 5.2.11. Please delete this added condition. It is not standard to request that As-Built drawings be completed monthly.

Answer: The deletion of the added condition in GC 5.2.11 regarding monthly completion of As-Built drawings is accepted.

Question 17: Please see Appendix 3, See Supplementary Conditions. See GC 5.4.1. Please remove "two times" from this condition.

Answer: The wording of GC 5.4.1 will remain unchanged.

Question 18: Please see Appendix 3, See Supplementary Conditions. See GC 6.1.7. We request that Section 6.1.7 not be deemed to include any and all claims for delay. At the time of a change order, it may not be reasonably possible for the Contractor to determine, with any specificity, the exact delay which may result from a change. As such, we request that this section remove such notation and leave delays to be claimed under GC 6.5 of the Contract, as and if a delay occurs.

Answer: The wording of GC 6.1.7 will remain unchanged.

Question 19: Please see Appendix 3, See Supplementary Conditions. See GC 6.2.3. We request that you remove the following items from this condition (and thus allowing them to be part of General Conditions) a. Supervision. If a change extends the overall schedule, the contractor should be reimbursed for the additional cost of supervision. b. Insurance. Insurance is charged based on the value of the project as well as the duration. As a change increases the value and/or the schedule of the project, the cost of insurance increases. c. Cellphones. If a change extends the overall schedule, the contractor should be reimbursed for the additional costs of communications. d. Site Trailers. If a change extends the overall schedule, the contractor should be reimbursed for the additional cost of the site trailer.

Answer:
a. The current wording regarding supervision and reimbursement for additional costs due to schedule extensions will remain unchanged.
b. The wording regarding insurance costs related to changes in project value and duration will remain unchanged.
c. The wording regarding reimbursement for additional communication costs due to schedule extensions will remain unchanged.
d. The wording regarding reimbursement for additional site trailer costs due to schedule extensions will remain unchanged.

Question 20: Please see Appendix 3, See Supplementary Conditions. See GC 6.5.6. Can you please clarify the intent of Section 6.5.6; namely, that any “float” will first be used to rectify / obviate any delay within the schedule (including any delay or extension of time that would otherwise result from a change order or directive), then, any remaining time will be shared equitably by and between the Owner and Contractor.

Answer: You can only get an extension of time or extra payment for delays if you’ve done everything reasonably possible to avoid or reduce the delay and its cost—and can prove it with proper documentation.

Float is extra time built into the schedule. It doesn’t belong just to you or just to the owner. It’s meant to be used first to absorb delays before any extension of time is granted. If there’s float available when a delay happens, that delay won’t lead to more time being added to the schedule. Any remaining float is to be fairly shared between you and the owner.

Action:
Please identify any potential float time in your preliminary construction schedule. This will help ensure clarity and proper management of time throughout the project.

Question 21: Please see Appendix 3, See Supplementary Conditions. See GC 6.5.9. We request this section be amended to be limited to damages resulting from “omissions, negligence or misconduct” and remove “act” – if a party simply “acts” and is not in violation of the contract or its standard of care, it should not be liable for a resulting delay.

Answer: The current wording of GC 6.5.9 will remain unchanged at this time.

Question 22: Please see Appendix 3, See Supplementary Conditions. See GC 7.1.7.1. We request that item 7.1.7.1 be amended to the following: "if the Contractor fails to abide by the Construction Act with respect to prompt payment, subject to the Owner being in full compliance with its prompt payment obligations to the Contractor under this Contract."

Answer: The wording of GC 7.1.7.1 will remain unchanged.

Question 23: Please see Appendix 3, See Supplementary Conditions. See GC 7.2.2. We request that this section be reinstated. The full deletion of this provision results in the Contractor never being permitted to terminate the contract in the face of a suspension of work by public order / court order and essentially could leave the Contractor "on hold" indefinitely. In the alternative, we request this section be re-instated and change "20 working days" to "90 working days".

Answer: The wording of GC 7.2.2 will remain unchanged.

Question 24: Please see Appendix 3, See Supplementary Conditions. We request that this section be amended so that the Contractor only be liable if the Owner disclosed the toxic or hazardous substance to the Contractor. If the Owner does not disclose it, and if the Contractor discovers the substance (but it has already caused damage), the Contractor should not be liable for same. Substances that already exist at the place of work should be the responsibility of the Owner to disclose.

Answer: The wording will remain unchanged.

Question 25: Please clarify if the cost for shipping and recycling of carpet is to be included in our tender price or if we are just to include preparing it for transport and loading of the truck?

Answer: Tarkett ReStart program covers the cost of shipping and recycling. The GC only needs to include preparing the material for transport and loading it onto the truck. They will also need to cover the cost of the pallets.

Question 26: (During Job Showing) Is a Site Supervisor required on this project?

Answer: Yes, a Site Supervisor is required on this project. Refer to Specification Section 01 00 50 General Instructions, 1.35 Supervision.

.1 The overall superintendence of the Project, ensuring the complete performance of all subcontractors and suppliers, is the responsibility of the Contractor. A fully competent Site Superintendent acceptable to Consultant and the Owner shall be in charge and in attendance of the work at all times throughout the Contract. The superintendent shall have a minimum of 5 years experience in similar scale and type of Work.

Question 27: (During Job Showing) Are after hours allowed on this project?

Answer: Normal working hours are Monday to Friday, 6am – 4pm. After hours are permitted, but no FA bypass or hot work during after hours.

Question 28: (During Job Showing) Is there a DSR for this building?

Answer: See attached 'ACM Update 2023 Leeds'.

Appendix 5 – Rate Bid Form - Modifications/Additions
DELETE: Rate bid form attached to original documents.
INCLUDE: Revised Rate bid form attached to this addendum

Additional Cash Allowances:

- Cash Allowance for Moving and Reinstating existing furniture and fridges in Suites is $48,364.00.
- Cash Allowance for Shut-off valve replacements is $5000.00.
- Cash Allowance for New furniture (Dinning table and chairs, Bedroom desks and chairs) is $391,153.53.

Attachment 2 – IFT Drawings modifications/additions and Attachment 2.1 – Leeds IFT Specifications modification/additions

1.1 Description of Work – Moving furniture under cash allowance, removal of desks, dining tables and chairs, new furniture under cash allowance

.1 Specification Section 01 00 50 General Instructions, Part 1- General, 1.1 Description of Work

.1 ADD scope of work to Item 1:

- Remove Servery dining table and chairs and one desk and chair per Bedroom within all Suites in scope.
- Move and reinstate existing Suite furniture and fridges.

.2 REVISE Item 4 to: General Contractor to coordinate moving existing Bedroom Suite furniture and fridges under cash allowance to complete removal and installation of the flooring. Within the Bedroom Suites, remove the Servery's dining table and chairs and one desk and chair per Bedroom. All other existing furniture and appliances to be reinstated will be stored in 2 Suites per floor. These rooms will be required to be renovated last. Reinstate existing furniture after completion of the work. New dinning tables and chairs and bedroom desks and chairs to be provided under cash allowance.

.2 DRAWING A01 GENERAL NOTES AND A02-A06 DEMOLITION WORK - GENERAL NOTES

.1 REVISE General Notes:
General Contractor to remove Servery's dining table and chairs and one desk and chair per Bedroom in all Suites within area of work. General Contractor to relocate all other existing furniture and fridges within the Bedroom Suites to complete removal and installation of the flooring. Furniture to be stored in 2 suites per floor. These rooms will be required to be renovated last. Designated staging suites to be coordinated with client. Reinstate existing furniture and appliances after the completion of work along with new dinning tables and chairs and bedroom desks and chairs.

.2 REVISE Demolition Work - General Notes, Item 3:
Contractor to remove Servery's dining table and chairs and one desk and chair per Bedroom in all Suites within area of work. Carleton University will relocate wall mounted TVs and window coverings in the area of work prior to contractor mobilization. General Contractor to relocate all other loose furniture and appliances. Furniture to be stored in 2 suites per floor. These rooms will be required to be renovated last. Designated staging suites to be coordinated with client. Reinstate existing furniture and appliances after the completion of work along with new dinning tables and chairs and bedroom desks and chairs.

1.2 Description of Work – Removal of existing signage

.1 Specification Section 01 00 50 General Instructions, Part 1- General, 1.1 Description of Work

.1 ADD scope of work to Item 1:

- Remove existing signage from doors and walls. Carleton University sub-contractor will supply and install new signage.

.2 DRAWING A01 GENERAL NOTES AND A02-A06 DEMOLITION WORK - GENERAL NOTES

.1 REVISE General Notes:
Remove existing signage from doors and walls within area of work. Patch and repair gypsum board at removals. Refer to attached drawing A01.

.2 REVISE Demolition Work - General Notes, Item 3:

- Removal of existing signage from doors and walls.

1.3 Description of Work – New Corner Guards

.1 Specification Section 01 00 50 General Instructions, Part 1- General, 1.1 Description of Work

.1 ADD scope of work to Item 1:

- Supply and install of new stainless steel corner guards in corridors.

.2 DRAWING 2/A06, DRAWING LEGEND & NEW WORK - GENERAL NOTES A02–A06

.1 ADD the provision of corner guards in all corridors within area of work:
Stainless Steel Corner Guards: In satin finish, surface mounted, 1.5 mm thick (16 gauge) min. 3-1/2" (89mm) wing, with beveled edges.
Suggested (or equivalent) products:
1. "SCO-8 Series" by Construction Specialties Inc.
2. "Stainless Steel Corner Guard GS series" by Korogard.
Corner guards to be both glued (low VOC) and mechanically fastened as per manufacturer's written instruction. Length to be 1200 mm.

Provide 320 corner guards for Levels 1 to 6, including wide angled corner in corridor near elevator lobby. Locations to be confirmed on site during construction with Architect and Carleton University.


Refer to attached Typical Corner Guards drawing 2/A06, Wide Angle Corner Guards drawing 3/A06, and revised New Work – General Notes and Drawing Legend on Drawings.


1.4 Description of Work – Existing shut-off valve replacements under cash allowance

.1 DRAWINGS 1, 2, 3, 4/A05

.1 ADD note in all suite washrooms within scope to replace any damaged or corroded existing shut-off valves as required. Refer to attached drawings 1, 2, 3, 4/A05.

.2 Goodkey Weedmark & Associates Limited's Mechanical as-built drawings (January 4, 2002) show shut-off valves in both the suite washrooms and in the main corridors.

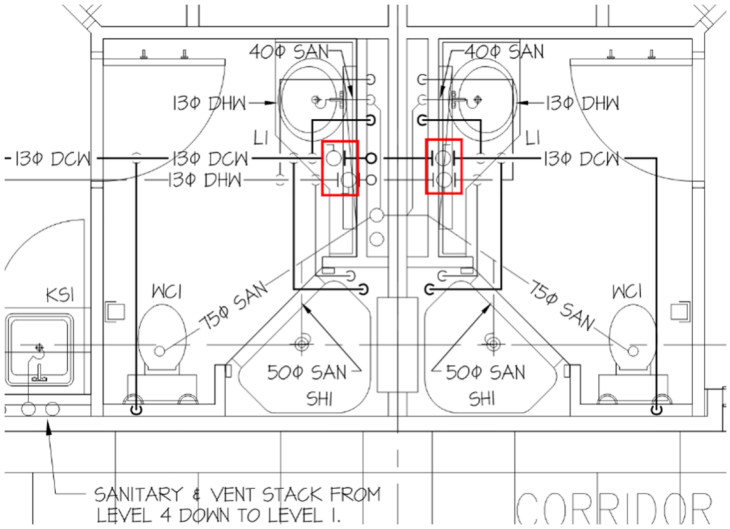

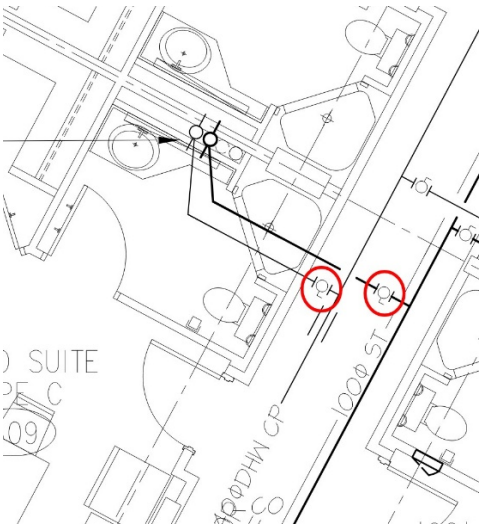

1.5 Description of Work – Elevator Cleaning

.1 DRAWING A01 GENERAL NOTES


.1 **ADD** to General Notes:

Elevator cabinets and elevator shafts: General Contractor to provide and maintain temporary protection of existing elevator cabinets throughout demolition and construction. After all demolition and grinding work is completed, The General Contractor is to clean the elevator cabinet and shaft from debris and dust.

1.6 Description of Work – Flooring products

.1 **ADD** in Specification Sections 09 65 16 Resilient Sheet Flooring, 09 65 19 Luxury Vinyl Tile Flooring and 09 68 00 Modular Carpet, Part 2 Products: There are no acceptable alternatives for Tarkett flooring products, wall base or transition strip products named.


END OF ADDENDUM 2

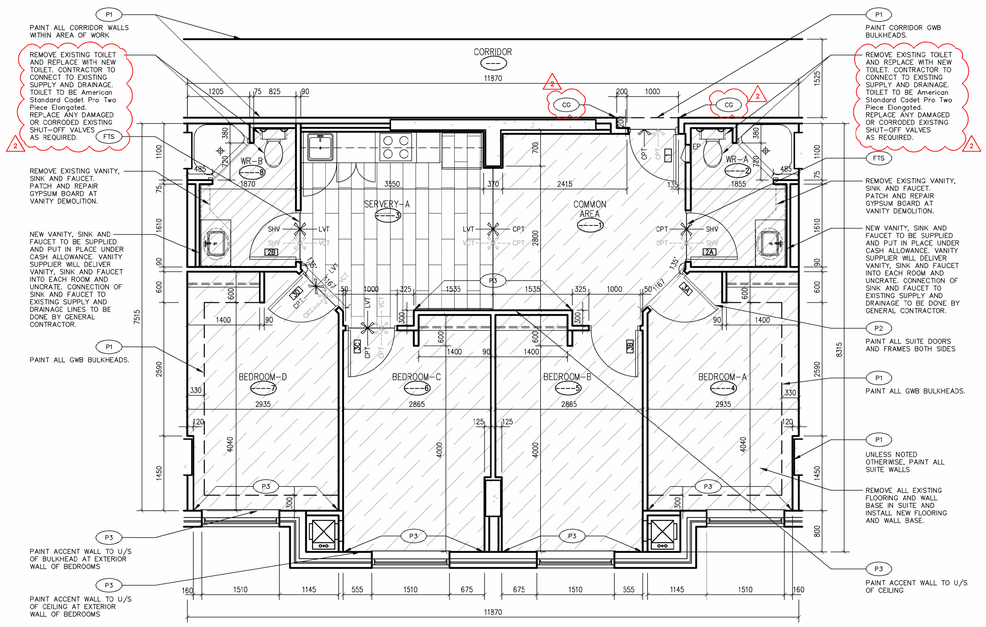

NOTES:
51 SUITE TYPE A UNITS ON LEVELS 1 TO 4.

EXISTING GWB CEILING HEIGHT IN SUITES IS 2300 AFF AT LEVELS 2 TO 5 AND 3170 AFF AT LEVELS 1 AND 6. TYPICAL BULKHEADS IN SUITES ARE 2210 AFF. EXISTING ACT CEILING HEIGHT IN CORRIDORS IS 2350 AFF. TYPICAL GWB BULKHEADS IN CORRIDORS ARE 2300 AFF.


1 A05 SUITE TYPE A PARTIAL PLAN - DEMO AND NEW WORK
1:50

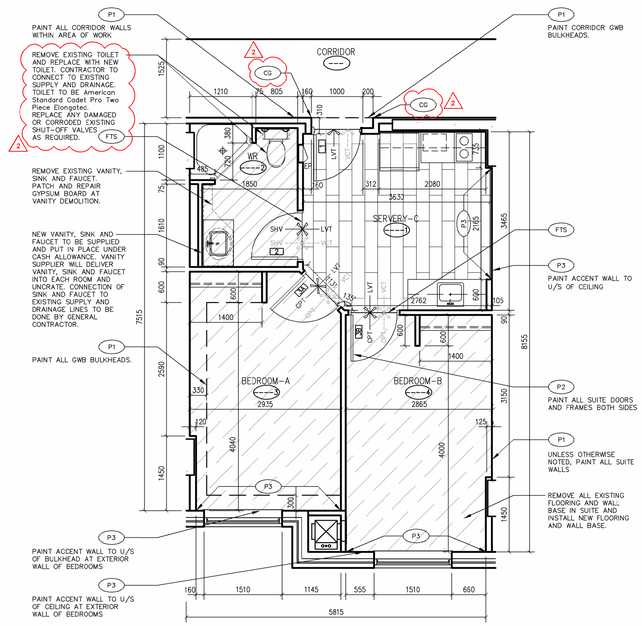

NOTES:
75 SUITE TYPE C UNITS ON LEVELS 2 TO 6.

EXISTING GWB CEILING HEIGHT IN SUITES IS 2300 AFF AT LEVELS 2 TO 5 AND 3170 AFF AT LEVELS 1 AND 6. TYPICAL BULKHEADS IN SUITES ARE 2210 AFF. EXISTING ACT CEILING HEIGHT IN CORRIDORS IS 2350 AFF. TYPICAL GWB BULKHEADS IN CORRIDORS ARE 2300 AFF.


2 A05 SUITE TYPE C PARTIAL PLAN - DEMO AND NEW WORK
1:50

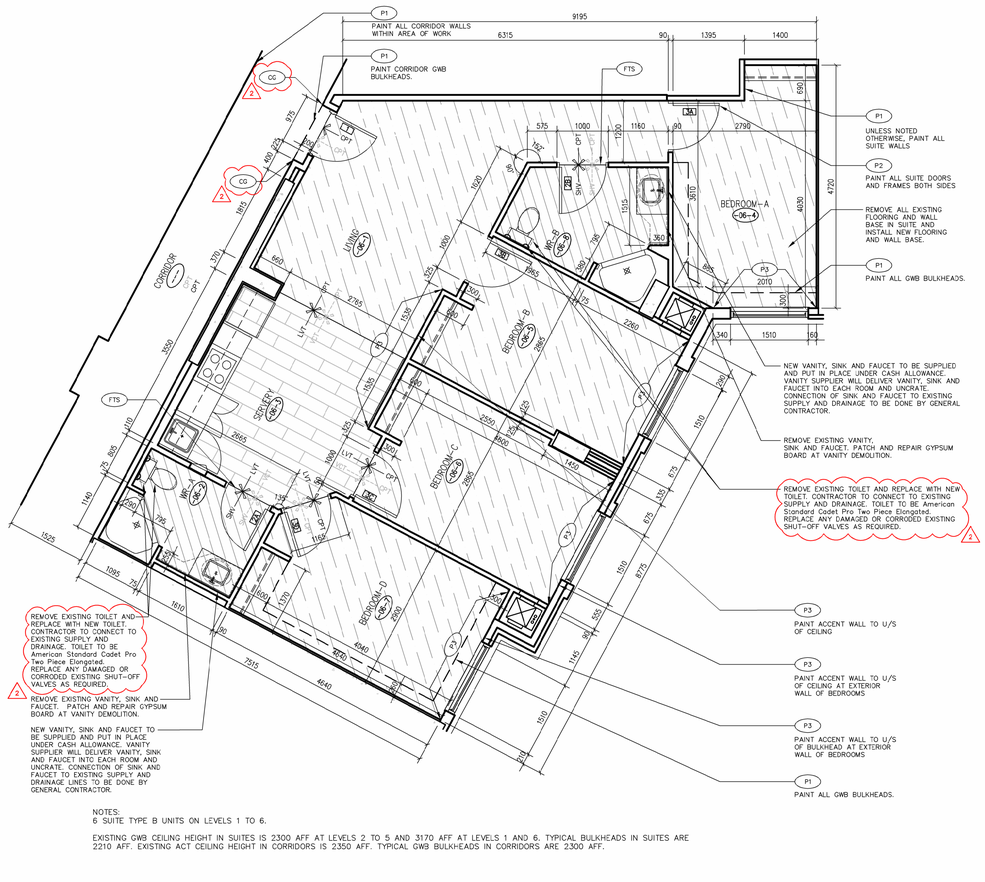

NOTES:
6 SUITE TYPE B UNITS ON LEVELS 1 TO 6.

EXISTING GWB CEILING HEIGHT IN SUITES IS 2300 AFF AT LEVELS 2 TO 5 AND 3170 AFF AT LEVELS 1 AND 6. TYPICAL BULKHEADS IN SUITES ARE 2210 AFF. EXISTING ACT CEILING HEIGHT IN CORRIDORS IS 2350 AFF. TYPICAL GWB BULKHEADS IN CORRIDORS ARE 2300 AFF.

3 A05 SUITE TYPE B PARTIAL PLAN - DEMO AND NEW WORK
1:50

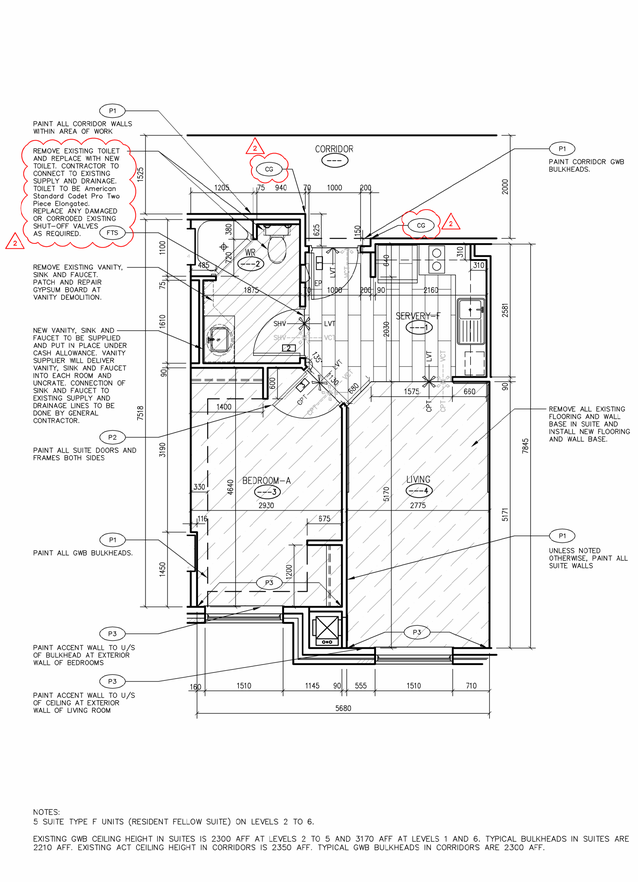

NOTES:
5 SUITE TYPE F UNITS (RESIDENT FELLOW SUITE) ON LEVELS 2 TO 6.

EXISTING GWB CEILING HEIGHT IN SUITES IS 2300 AFF AT LEVELS 2 TO 5 AND 3170 AFF AT LEVELS 1 AND 6. TYPICAL BULKHEADS IN SUITES ARE 2210 AFF. EXISTING ACT CEILING HEIGHT IN CORRIDORS IS 2350 AFF. TYPICAL GWB BULKHEADS IN CORRIDORS ARE 2300 AFF.

4 A05 SUITE TYPE F PARTIAL PLAN - DEMO AND NEW WORK
1:50

DEMOLITION WORK - GENERAL NOTES:

1. CONTRACTOR TO REMOVE SERVERY'S DINNING TABLE AND CHAIRS AND ONE DESK AND CHAIRS PER BEDROOM IN ALL SUITES WITHIN AREA OF WORK. CARLETON UNIVERSITY WILL RELOCATE WALL MOUNTED TVS AND WINDOW COVERINGS IN THE AREA OF WORK PRIOR TO CONTRACTOR MOBILIZATION. GENERAL CONTRACTOR TO RELOCATE ALL OTHER LOOSE FURNITURE AND APPLIANCES. FURNITURE TO BE STORED IN 2 SUITES PER FLOOR. THESE ROOMS WILL BE REQUIRED TO BE RENOVATED LAST. DESIGNATED STAGING SUITES TO BE COORDINATED WITH CLIENT. REINSTATE EXISTING FURNITURE AND APPLIANCES AFTER THE COMPLETION OF WORK ALONG WITH NEW DINNING TABLES AND CHAIRS AND BEDROOM DESKS AND CHAIRS.
2. PRIOR TO PREPARATION AND PAINTING OF WALLS AND DOORS, GENERAL CONTRACTOR TO REMOVE ANY UNUSED WIRE MOULDS AND WALL OR DOOR ACCESSORIES (3M HOOKS). CONTRACTOR TO REMOVE AND REINSTALL BATHROOM HOLDERS MOUNTED ABOVE TOILETS AND WIRE SHELVES IN CLOSETS. SUITE BATHROOM MIRRORS TO REMAIN IN PLACE DURING WORK.
3. DEMOLITION WORK INCLUDES (BUT NOT INCLUSIVE) THE FOLLOWING:
   - REMOVAL OF EXISTING FLOORING AND WALL BASE
   - REMOVAL OF EXISTING VANITY, SINK, FAUCET AND TOILET IN SUITE WASHROOMS.
   - REMOVAL OF EXISTING SIGNAGE FROM DOORS AND WALLS.

NEW WORK - GENERAL NOTES:

1. NEW WORK INCLUDES (BUT NOT INCLUSIVE) THE FOLLOWING:
   - NEW FLOORING
   - NEW WALL BASE
   - NEW FLOOR TRANSITIONS
   - PAINTING WALLS AND GYPSUM BULKHEADS
   - PAINTING DOORS AND FRAMES BOTH SIDES
   - NEW CORNER GUARDS
   - NEW VANITY, SINK AND FAUCET TO BE SUPPLIED AND PUT IN PLACE UNDER CASH ALLOWANCE. VANITY SUPPLIER WILL DELIVER VANITY, SINK AND FAUCET INTO EACH ROOM AND UNCRATE. CONNECTION OF SINK AND FAUCET TO EXISTING DRAINAGE AND SUPPLY LINES TO BE DONE BY GENERAL CONTRACTOR.
   - TOILET TO BE SUPPLIED AND INSTALLED BY GENERAL CONTRACTOR. TOILET TO BE American Standard Cadet Pro Two Piece Elongated.
   - NEW DINNING TABLE AND CHAIRS AND BEDROOM DESKS AND CHAIRS SUPPLIED AND INSTALLED UNDER CASH ALLOWANCE
2. PROVIDE TRANSITION STRIPS BETWEEN DISSIMILAR MATERIALS. TRANSITION STRIPS NOT REQUIRED BETWEEN NEW CARPET TILE AND NEW LVT FLOORING.
3. CONCEAL ALL FLOOR TRANSITIONS UNDER DOOR OPENINGS.
4. ALL PRODUCTS TO BE INSTALLED AS PER MANUFACTURERS SPECIFICATIONS.
5. ENSURE WALL BASE FINISHES BEHIND EQUIPMENT AND APPLIANCES ARE COMPLETE. FLOOR FINISHES TO RUN UNDER EQUIPMENT, APPLIANCES AND BATHROOM VANITIES.
6. AT INSTALLATION OF MILLWORK BASE IN SUITE WASHROOMS APPLY CLEAR SILICONE TO THE JUNCTURE OF THE WALL AND THE FLOOR. WHILE THE SILICONE IS STILL WET, INSTALL THE MILLWORK WALL BASE TO CREATE A WATERPROOF SEAL. REFER TO SPEC SECTION 09 65 16.

DRAWING LEGEND:

ROOM NAME (##) — ROOM NAME AND NUMBER TAG

EXISTING DOOR AND FRAME

DEMO EXISTING TOILET, VANITY, SINK AND FAUCET

NEW TOILET, VANITY, SINK AND FAUCET

FLOORING & FINISH LEGEND:

SHV / VCT — DEMO EXISTING FLOORING AND WALL BASE

SHV / LVT — NEW FLOORING AND WALL BASE

NEW CARPET TILE (CPT) - SUITE BEDROOMS, SUITE COMMON AREAS, CORRIDORS, LOUNGES

REMOVE EXISTING CARPET TILE AND WALL BASE
NEW FLOORING TYPE: TARKETT SHIFT PRINT
COLOUR: 24211 CONFLUENCE

NEW BASE TYPE: JOHNSONITE PERCEPTIONS, "CONTOUR"
COLOUR: TA8 WELSH CASTLE

NEW LUXURY VINYL TILE (LVT) - SUITE SERVERIES

REMOVE EXISTING VCT AND WALL BASE
NEW FLOORING TYPE: TARKETT EVEN PLANE WOOD
COLOUR: ENGLISH OAK 8708 WARM GREIGE

NEW BASE TYPE: JOHNSONITE PERCEPTIONS, "CONTOUR"
COLOUR: TA8 WELSH CASTLE

NEW SHEET VINYL (SHV) - SUITE WASHROOMS

REMOVE EXISTING SHEET VINYL AND WALL BASE
NEW FLOORING TYPE: TARKETT ARIA
COLOUR: 855 GYPSY MOTH

NEW BASE TYPE: JOHNSONITE MILLWORK WALL BASE, "EXHIBIT"
COLOUR: TA8 WELSH CASTLE

FTS — FLOORING TRANSITION STRIP
JOHNSONITE WHEELED TRAFFIC TRANSITION CTA-XX-HT
COLOUR: TA8 WELSH CASTLE

PAINT LEGEND:

P1 — UNLESS NOTED OTHERWISE, PAINT ALL EXISTING WALLS AND BULKHEADS IN BASE COLOUR WITHIN AREA OF WORK
COLOUR: SHERWIN-WILLIAMS CUSTOM BEIGE (REFER TO SPEC SECTION 09 91 23.01)

P2 — EXISTING DOORS AND FRAMES TO BE REPAINTED ON BOTH SIDES (SUITE ENTRANCE VENEER DOORS EXCLUDED, ONLY FRAMES TO BE REPAINTED)
COLOUR: MATCH EXISTING PAINTED DOOR AND FRAME COLOUR

P3 — ACCENT WALLS IN SUITES
COLOUR: SHERWIN-WILLIAMS INTERESTING AQUA SW 6220

P4 — ACCENT WALL IN LOUNGES
COLOUR: SHERWIN-WILLIAMS TCILE RED SW 0006

WALL PROTECTION:

CG — STAINLESS STEEL CORNER GUARDS: IN SATIN FINISH, SURFACE MOUNTED, 1.5 mm THICK (16 GAUGE) MIN. 3-1/2" (89 mm) WING, WITH BEVELED EDGES.
CORNER GUARDS TO BE BOTH GLUED (LOW VOC) AND MECHANICALLY FASTENED AS PER MANUFACTURER'S WRITTEN INSTRUCTIONS. LENGTH TO BE 1200 mm.
SUGGESTED (OR EQUIVALENT) PRODUCTS:
1. "SCC-8 SERIES" BY CONSTRUCTION SPECIALITIES INC.
2. "STAINLESS STEEL CORNER GUARD GS SERIES" BY KOROGARD.

wmta
info@wmta.ca
t 613 232 0330
400-116 Lisgar Street Ottawa Ontario Canada K2P 0C2

true north / project north

scale: REFER TO DRAWING

No.	Description	Date
2	ISSUED FOR ADDENDUM NO.2	2026-03-10
1	ISSUED FOR TENDER	2026-02-20

Revision Schedule

A/C — A detail no. / B drawing location no. / C drawing no.


A/BC

project
CARLETON UNIVERSITY LEEDS HOUSE RENOVATION

drawing
ENLARGED PARTIAL SUITE PLANS

designed: MJAW 2025-12-08
drawn: MJAW 2026-01-26
revised:
approved:
tender: 2026-02-20
project no.: CU Project No. 190223 (WMTA 2586)
drawing no.: A05


2586-E1-1-003 CU Leeds Renovation

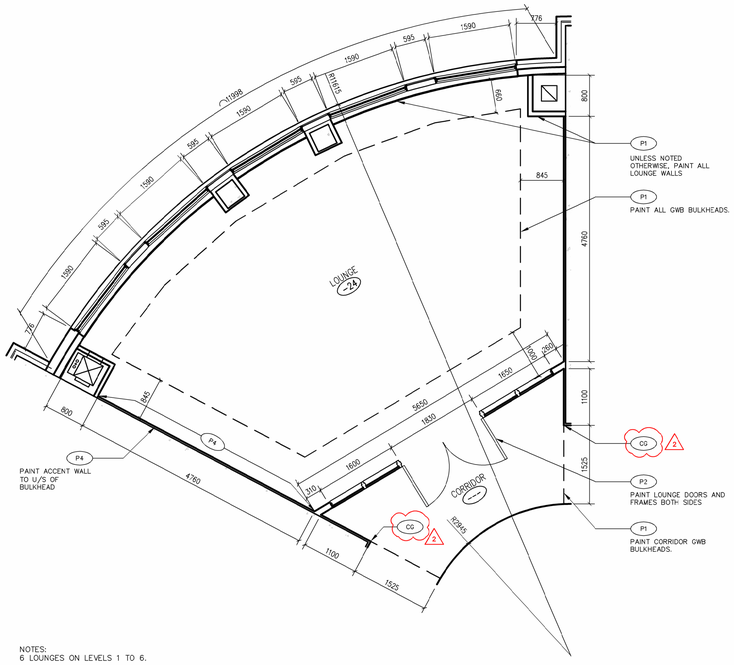


NOTES:
6 LOUNGES ON LEVELS 1 TO 6.

EXISTING ACOUSTIC CEILING TILE CEILING HEIGHT IN LOUNGES IS 2650 AFF. TYPICAL BULKHEADS IN LOUNGES ARE 2600 AFF.
EXISTING ACT CEILING HEIGHT IN CORRIDORS IS 2350 AFF. TYPICAL GWB BULKHEADS IN CORRIDORS ARE 2300 AFF.

1 A/6 LOUNGE PARTIAL PLAN - DEMO AND NEW WORK
1:50

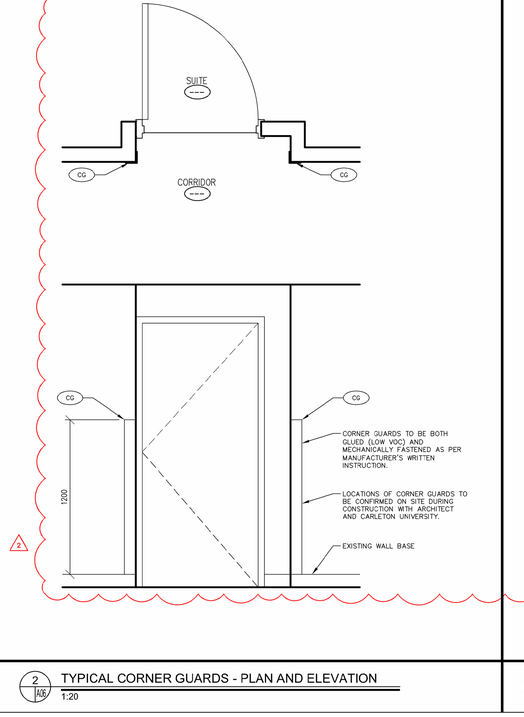

2 A/6 TYPICAL CORNER GUARDS - PLAN AND ELEVATION
1:20

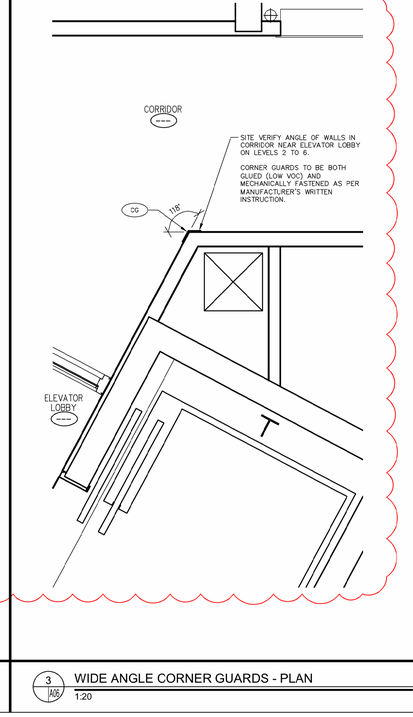

3 A/6 WIDE ANGLE CORNER GUARDS - PLAN
1:20

DEMOLITION WORK - GENERAL NOTES:

1. CONTRACTOR TO REMOVE SERVERY'S DINNING TABLE AND CHAIRS AND ONE DESK AND CHAIRS PER BEDROOM IN ALL SUITES WITHIN AREA OF WORK. CARLETON UNIVERSITY WILL RELOCATE WALL MOUNTED TVS AND WINDOW COVERINGS IN THE AREA OF WORK PRIOR TO CONTRACTOR MOBILIZATION. GENERAL CONTRACTOR TO RELOCATE ALL OTHER LOOSE FURNITURE AND APPLIANCES. FURNITURE TO BE STORED IN 2 SUITES PER FLOOR. THESE ROOMS WILL BE REQUIRED TO BE RENOVATED LAST. DESIGNATED STAGING SUITES TO BE COORDINATED WITH CLIENT. REINSTATE EXISTING FURNITURE AND APPLIANCES AFTER THE COMPLETION OF WORK ALONG WITH NEW DINNING TABLES AND CHAIRS AND BEDROOM DESKS AND CHAIRS. (2)
2. PRIOR TO PREPARATION AND PAINTING OF WALLS AND DOORS, GENERAL CONTRACTOR TO REMOVE ANY UNUSED WIRE MOULDS AND WALL OR DOOR ACCESSORIES (3M HOOKS). CONTRACTOR TO REMOVE AND REINSTALL BATHROOM HOLDERS MOUNTED ABOVE TOILETS AND WIRE SHELVES IN CLOSETS. SUITE BATHROOM MIRRORS TO REMAIN IN PLACE DURING WORK.
3. DEMOLITION WORK INCLUDES (BUT NOT INCLUSIVE) THE FOLLOWING:
   - REMOVAL OF EXISTING FLOORING AND WALL BASE
   - REMOVAL OF EXISTING VANITY, SINK, FAUCET AND TOILET IN SUITE WASHROOMS.
   - REMOVAL OF EXISTING SIGNAGE FROM DOORS AND WALLS. (2)

NEW WORK - GENERAL NOTES:

1. NEW WORK INCLUDES (BUT NOT INCLUSIVE) THE FOLLOWING:
   - NEW FLOORING
   - NEW WALL BASE
   - NEW FLOOR TRANSITIONS
   - PAINTING WALLS AND GYPSUM BULKHEADS
   - PAINTING DOORS AND FRAMES BOTH SIDES
   - NEW CORNER GUARDS (2)
   - NEW VANITY, SINK AND FAUCET TO BE SUPPLIED AND PUT IN PLACE UNDER CASH ALLOWANCE. VANITY SUPPLIER WILL DELIVER VANITY, SINK AND FAUCET INTO EACH ROOM AND UNCRATE. CONNECTION OF SINK AND FAUCET TO EXISTING DRAINAGE AND SUPPLY LINES TO BE DONE BY GENERAL CONTRACTOR.
   - TOILET TO BE SUPPLIED AND INSTALLED BY GENERAL CONTRACTOR. TOILET TO BE American Standard Cadet Pro Tall Pixel Elongated. (2)
   - NEW DINNING TABLE AND CHAIRS AND BEDROOM DESKS AND CHAIRS SUPPLIED AND INSTALLED UNDER CASH ALLOWANCE
2. PROVIDE TRANSITION STRIPS BETWEEN DISSIMILAR MATERIALS. TRANSITION STRIPS NOT REQUIRED BETWEEN NEW CARPET TILE AND NEW LVT FLOORING.
3. CONCEAL ALL FLOOR TRANSITIONS UNDER DOOR OPENINGS.
4. ALL PRODUCTS TO BE INSTALLED AS PER MANUFACTURERS SPECIFICATIONS.
5. ENSURE WALL BASE FINISHES BEHIND EQUIPMENT AND APPLIANCES ARE COMPLETE. FLOOR FINISHES TO RUN UNDER EQUIPMENT, APPLIANCES AND BATHROOM VANITIES.
6. AT INSTALLATION OF MILLWORK BASE IN SUITE WASHROOMS APPLY CLEAR SILICONE TO THE JUNCTURE OF THE WALL AND THE FLOOR. WHILE THE SILICONE IS STILL WET, INSTALL THE MILLWORK WALL BASE TO CREATE A WATERPROOF SEAL. REFER TO SPEC SECTION 09 65 16.

DRAWING LEGEND:

ROOM_NAME (HH) — ROOM NAME AND NUMBER TAG

EXISTING DOOR AND FRAME

DEMO EXISTING TOILET, VANITY, SINK AND FAUCET

NEW TOILET, VANITY, SINK AND FAUCET

FLOORING & FINISH LEGEND:

SHV — VCT — DEMO EXISTING FLOORING AND WALL BASE

SHV — LVT — NEW FLOORING AND WALL BASE

NEW CARPET TILE (CPT) - SUITE BEDROOMS, SUITE COMMON AREAS, CORRIDORS, LOUNGES

REMOVE EXISTING CARPET TILE AND WALL BASE
NEW FLOORING TYPE: TARKETT SHIFT PRINT
COLOUR: 24211 CONFLUENCE

NEW BASE TYPE: JOHNSONITE PERCEPTIONS, "CONTOUR"
COLOUR: TA8 WELSH CASTLE

NEW LUXURY VINYL TILE (LVT) - SUITE SERVERIES

REMOVE EXISTING VCT AND WALL BASE
NEW FLOORING TYPE: TARKETT EVEN PLANE WOOD
COLOUR: ENGLISH OAK 8706 WARM GREIGE

NEW BASE TYPE: JOHNSONITE PERCEPTIONS, "CONTOUR"
COLOUR: TA8 WELSH CASTLE

NEW SHEET VINYL (SHV) - SUITE WASHROOMS

REMOVE EXISTING SHEET VINYL AND WALL BASE
NEW FLOORING TYPE: TARKETT ARIA
COLOUR: 855 GYPSY MOTH

NEW BASE TYPE: JOHNSONITE MILLWORK WALL BASE, "EXHIBIT"
COLOUR: TA8 WELSH CASTLE

FTS — FLOORING TRANSITION STRIP
JOHNSONITE WHEELED TRAFFIC TRANSITION CTA-XX-HT
COLOUR: TA8 WELSH CASTLE

PAINT LEGEND:

P1 — UNLESS NOTED OTHERWISE, PAINT ALL EXISTING WALLS AND BULKHEADS IN BASE COLOUR WITHIN AREA OF WORK
COLOUR: SHERWIN-WILLIAMS CUSTOM BEIGE (REFER TO SPEC SECTION 09 91 23.01)

P2 — EXISTING DOORS AND FRAMES TO BE REPAINTED ON BOTH SIDES (SUITE ENTRANCE VENEER DOORS EXCLUDED, ONLY FRAMES TO BE REPAINTED)
COLOUR: MATCH EXISTING PAINTED DOOR AND FRAME COLOUR

P3 — ACCENT WALLS IN SUITES
COLOUR: SHERWIN-WILLIAMS INTERESTING AQUA SW 6220

P4 — ACCENT WALL IN LOUNGES
COLOUR: SHERWIN-WILLIAMS TCILE RED SW 0006

WALL PROTECTION:

CG — STAINLESS STEEL CORNER GUARDS: IN SATIN FINISH, SURFACE MOUNTED, 1.5 mm THICK (16 GAUGE) MIN. 3-1/2" (89 mm) WING, WITH BEVELED EDGES.
CORNER GUARDS TO BE BOTH GLUED (LOW VOC) AND MECHANICALLY FASTENED AS PER MANUFACTURER'S WRITTEN INSTRUCTIONS. LENGTH TO BE 1200 mm.
SUGGESTED (OR EQUIVALENT) PRODUCTS:
1. "SCO-8 SERIES" BY CONSTRUCTION SPECIALITIES INC.
2. "STAINLESS STEEL CORNER GUARD GS SERIES" BY KOROGARD. (2)

wmta
info@wmta.ca
t 613 232 0330
400-116 Lisgar Street Ottawa Ontario Canada K2P 0C2

true north / project north

scale: REFER TO DRAWING

No.	Description	Date
2	ISSUED FOR ADDENDUM NO.2	2026-03-10
1	ISSUED FOR TENDER	2026-02-20

Revision Schedule

A/C — A detail no. / B drawing location no. / C drawing no. — A/BC

project
CARLETON UNIVERSITY LEEDS HOUSE RENOVATION

drawing
ENLARGED PARTIAL LOUNGE PLAN

designed	MJAW
date	2025-12-08
drawn	MJAW
date	2026-01-26
revised	
date	
approved	
date	
tender	2026-02-20
date	
project no.	CU Project No. 190223 (WMTA 2586)
drawing no.	A06

2586-E1-1-003 CU Leeds Renovation

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	7	701	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Steel Beams		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Fibreglass with Foil Covering or Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Fibreglass with Canvas/Plastic Covering or Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Tanks		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Pumps		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Yellow Firestop	< 1m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A		7th Floor Fig	Yellow Firestop	GEC-3OLE-5A-08A/B/C			
30	LE	7	703	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Steel Beams		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	6	601	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	6	602	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-5A-01	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-5A-05			
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	602A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-5A-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-5A-01	No access above solid ceiling.		
30	LE	6	602B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-5A-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-5A-01	No access above solid ceiling.		
30	LE	6	602C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-5A-05			
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
D/C - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	6	603	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04	No access above solid ceiling.		
30	LE	6	603A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	6	603B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	6	603C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	1160S-30-06			
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04	No access above solid ceiling.		
30	LE	6	604	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04	No access above solid ceiling.		
30	LE	6	604A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	6	604B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	6	604C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	1160S-30-06			
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04	No access above solid ceiling.		
30	LE	6	605	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04	No access above solid ceiling.		
30	LE	6	605A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	6	605B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	6	605C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	1160S-30-06			
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04	No access above solid ceiling.		

Carleton UNIVERSITY

Asbestos-Containing Material Record 2023

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	6	606	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04	No access above solid ceiling.			
30	LE	6	606A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	116OS-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	6	606B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	116OS-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	6	606C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	116OS-3O-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04	No access above solid ceiling.			
30	LE	6	607	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04	No access above solid ceiling.			
30	LE	6	607A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	116OS-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	6	607B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	116OS-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	6	607C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	116OS-3O-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04	No access above solid ceiling.			
30	LE	6	608	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04	No access above solid ceiling.			
30	LE	6	608A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	116OS-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	6	608B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	116OS-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	6	608C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	116OS-3O-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	6	609	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Drywall Joint Compound	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	609A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	6	609B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	6	609C	Floor	VSF 1 - Grey with White & Black Specs	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Drywall Joint Compound	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	610	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Drywall Joint Compound	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	610A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	6	610B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	6	610C	Floor	VSF 1 - Grey with White & Black Specs	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Drywall Joint Compound	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	611	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	40m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	17 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Drywall Joint Compound	20m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	611A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	6	611B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	6	611C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
				Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
D/C - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	6	611D	Wall	Drywall Joint Compound	20m	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Photo	11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	6	611E	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	611F	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	612	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont. **System**
P/C-Parging cement Mech = Mechanical
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	6	612A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	6	612B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	6	612C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	6	613	Floor	VFT 1, 30cm x 30cm - Black with White Fleck	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A		6th Floor Fig	VFT 1	GEC-30LE-SA-02A/B/C	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	15m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Vinyl Baseboard with Yellow Adhesive	6 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A		6th Floor Fig	Vinyl B/B	GEC-30LE-SA-02A/B/C				
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	6	614	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	6	614A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	6	614B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	6	614C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	6	615	Floor	VFT 1, 30cm x 30cm - Black with White Fleck	6m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 1	GEC-30LE-SA-02	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
				Wall	Drywall Joint Compound	17m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Vinyl Baseboard with Yellow Adhesive	7 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	6	616	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	47m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Vinyl Baseboard with Yellow Adhesive	27 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	ACT 1, 60cm x 120cm - Small Pinholes & Fissures	43m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03				
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	6	617	Floor	VFT 1, 30cm x 30cm - Black with White Fleck	6m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 1	GEC-30LE-SA-02	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
				Wall	Drywall Joint Compound	17m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Vinyl Baseboard with Yellow Adhesive	7 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	6	618	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	618A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	6	618B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	6	618C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	619	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	619A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	6	619B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	6	619C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	620	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	620A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	6	620B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	6	620C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	6	621	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04	No access above solid ceiling.		
30	LE	6	621A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	116OS-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	6	621B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	116OS-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	6	621C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	116OS-3O-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04	No access above solid ceiling.		
30	LE	6	622	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04	No access above solid ceiling.		
30	LE	6	622A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	116OS-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	6	622B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	116OS-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	6	622C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	116OS-3O-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04	No access above solid ceiling.		
30	LE	6	623	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04	No access above solid ceiling.		
30	LE	6	623A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	116OS-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	6	623B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	116OS-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	6	623C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	116OS-3O-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
D/C - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	6	624	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04	No access above solid ceiling.		
30	LE	6	624A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	6	624B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	6	624C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	1160S-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04	No access above solid ceiling.		
30	LE	6	625	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04	No access above solid ceiling.		
30	LE	6	625A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	6	625B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	6	625C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	1160S-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04	No access above solid ceiling.		
30	LE	6	626	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04	No access above solid ceiling.		
30	LE	6	626A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	6	626B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	6	626C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	1160S-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	1160S-30-04 1160S-30-04	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
D/C - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	6	627	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	627A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	6	627B	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	628	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	628A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	6	628B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	6	628C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	629	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	7 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Electrical		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	6	630	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	116OS-30-06			
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	7 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Electrical		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	6	631	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04	No access above solid ceiling.		
30	LE	6	631A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	116OS-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	6	631B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	116OS-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	6	631C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	116OS-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04	No access above solid ceiling.		
30	LE	6	632	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04	No access above solid ceiling.		
30	LE	6	632A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	116OS-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	6	632B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	116OS-30-01 GEC-30LE-SA-01	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	6	632C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	633	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-5A-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	633A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-5A-01	No access above solid ceiling.		
30	LE	6	633B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-5A-01	No access above solid ceiling.		
30	LE	6	633C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	634	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-5A-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	634A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-5A-01	No access above solid ceiling.		
30	LE	6	634B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-5A-01	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	6	634C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	635	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-5A-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	635A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-5A-01	No access above solid ceiling.		
30	LE	6	635B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-5A-01	No access above solid ceiling.		
30	LE	6	635C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	636	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-5A-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	636A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-5A-01	No access above solid ceiling.		
30	LE	6	636B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-5A-01	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	6	636C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	637	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-5A-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	637A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-5A-01	No access above solid ceiling.		
30	LE	6	637B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-5A-01	No access above solid ceiling.		
30	LE	6	637C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	638	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-5A-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	638A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-5A-01	No access above solid ceiling.		
30	LE	6	638B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-5A-01	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	6	638C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	639	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-5A-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	639A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-5A-01	No access above solid ceiling.		
30	LE	6	639B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-5A-01	No access above solid ceiling.		
30	LE	6	639C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	640	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-5A-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	640A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-5A-01	No access above solid ceiling.		
30	LE	6	640B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-5A-01	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	6	640C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	641	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-5A-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	641A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-5A-01	No access above solid ceiling.		
30	LE	6	641B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-5A-01	No access above solid ceiling.		
30	LE	6	641C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	642	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-5A-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	642A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-5A-01	No access above solid ceiling.		
30	LE	6	642B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-5A-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-5A-01	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	6	642C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	643	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	643A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	6	643B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	6	643C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	644	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					On wall & columns.		
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	6	645	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$198m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	86 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	ACT 1, 60cm x 120cm - Small Pinholes & Fissures	$68m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03			
					Black Tar	**$1m^2$**	**YES**	**1**	**0.1743**	**17.43% CH**	**NO**	**1**	**$1m^2$**	**0**		**N/A**		**N/A**	**maintenance**	**2**	**0**	**N/A**	**N/A**	**Manage in Place**	**6th Floor Fig**	**Black Tar**	**GEC-30LE-SA-07A/B/C**	**Presumed beneath fibreglass and foil covering on rain water leader entering concrete deck.**	**Black tar is exposed in multiple locations in this corridor**	
					Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Fibreglass with Foil Covering on Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
D/C - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	6	646	Floor	VFT 3, 30cm x 30cm - Grey with Grey & White Smears	78m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 3	GEC-30LE-SA-04	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	58m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	21m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
					Drywall Joint Compound	21m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					ACT 1, 60cm x 120cm - Small Pinholes & Fissures	3m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03			
					Poured Concrete Deck							N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Fibreglass with Foil/Plastic Covering on Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	6	647	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					On wall & columns.		
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	6	648	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	198m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	86 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
					ACT 1, 60cm x 120cm - Small Pinholes & Fissures	68m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03			
				Ceiling	**Black Tar**	**1m^2**	**YES**	**1**	**0.1743**	**17.43% CH**	**NO**	**1**	**1m^2**	**0**		**N/A**		**N/A**	**maintenance**	**2**	**0**	**N/A**	**N/A**	**Manage in Place**	6th Floor Fig	**Black Tar**	**GEC-30LE-SA-07A/B/C**	**Presumed beneath fibreglass and foil covering on rain water leader entering concrete deck.**	**Black tar is exposed in multiple locations in this corridor**	
					Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	6	649	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	198m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	86 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
					ACT 1, 60cm x 120cm - Small Pinholes & Fissures	68m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03			
				Ceiling	**Black Tar**	**1.5m^2**	**YES**	**1**	**0.1743**	**17.43% CH**	**NO**	**1**	**1m^2**	**0**		**N/A**		**N/A**	**maintenance**	**2**	**0**	**N/A**	**N/A**	**Manage in Place**	6th Floor Fig	**Black Tar**	GEC-30LE-SA-07	**Presumed beneath fibreglass and foil covering on rain water leader entering concrete deck.**	**Black tar is exposed in multiple locations in this corridor**	
					Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	6	650	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					On wall & columns.		
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	5	501	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							

Carleton UNIVERSITY

Asbestos-Containing Material Record 2023

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	S	S02	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	S	S05A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	S	S02B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	S	S02C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	S	S03	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	S	S03A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	S	S03B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	S	S03C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	S	S04	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	S	S04A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	S	S04B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	S	S04C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	S	S05	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Drywall Joint Compound	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04	No access above solid ceiling.		
30	LE	S	S05A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	S	S05B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	S	S05C	Floor	VSF 1 - Grey with White & Black Specs	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	1160S-3O-06			
				Wall	Drywall Joint Compound	10m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Drywall Joint Compound	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04	No access above solid ceiling.		
30	LE	S	S06	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Drywall Joint Compound	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04	No access above solid ceiling.		
30	LE	S	S06A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	S	S06B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	S	S06C	Floor	VSF 1 - Grey with White & Black Specs	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	1160S-3O-06			
				Wall	Drywall Joint Compound	10m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Drywall Joint Compound	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04	No access above solid ceiling.		
30	LE	S	S07	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Drywall Joint Compound	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04	No access above solid ceiling.		
30	LE	S	S07A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	S	S07B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	S	S07C	Floor	VSF 1 - Grey with White & Black Specs	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	1160S-3O-06			
				Wall	Drywall Joint Compound	10m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Drywall Joint Compound	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
D/C - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	S	S08	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	S	S08A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	S	S08B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	S	S08C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	S	S09	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	S	S09A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	S	S09B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	S	S09C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	S	S10	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	S	S10A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	S	S10B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	S	S10C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	5	511	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	20m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	40m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	17 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	20m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	511A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	511B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	511C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	5	511D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	511E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	6	511F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	512	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	512A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	512B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	512C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	513	Floor	VFT 1, 30cm x 30cm - Black with White Fleck	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 1	GEC-30LE-SA-02	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
				Wall	Drywall Joint Compound	15m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Vinyl Baseboard with Yellow Adhesive	6 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	5	514	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	514A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	514B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	514C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			

Carleton UNIVERSITY

Asbestos-Containing Material Record 2023

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
D/C - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont. **System**
P/C-Parging cement Mech = Mechanical
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	5	515	Floor	VFT 1, 30cm x 30cm - Black with White Fleck	6m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 1	GEC-3OLE-SA-02	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	17m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	7 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	5	516	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	47m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	27 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	ACT 1, 60cm x 120cm - Small Pinholes & Fissures	43m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03			
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	5	517	Floor	VFT 1, 30cm x 30cm - Black with White Fleck	6m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 1	GEC-3OLE-SA-02	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	17m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	7 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	5	518	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	5	518A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	5	518B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	5	518C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	5	519	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	5	519A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	5	519B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	5	519C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	5	S20	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	S20A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	S20B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	S20C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	S21	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	S21A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	S21B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	S21C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	S22	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	S22A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	S22B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	S22C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	5	523	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A						
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	6	523A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A						
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	5	523B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A						
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	5	523C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	5	524	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A						
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	5	524A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A						
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	5	524B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A						
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	5	524C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	5	525	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A						
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	5	525A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A						
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	5	525B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A						
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	5	525C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
				Ceiling	Drywall Joint Compound	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-30-04 1160S-30-04	No access above solid ceiling.		
30	LE	5	526	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-30-04 1160S-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-30-04 1160S-30-04	No access above solid ceiling.			
30	LE	5	526A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-30-04 1160S-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	526B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-30-04 1160S-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	526C	Floor	VSF 1 - Grey with White & Black Specs	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	1160S-30-06				
				Wall	Drywall Joint Compound	10m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-30-04 1160S-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-30-04 1160S-30-04	No access above solid ceiling.			
30	LE	5	527	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-30-04 1160S-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-30-04 1160S-30-04	No access above solid ceiling.			
30	LE	5	527A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-30-04 1160S-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	527B	Floor	VSF 1 - Grey with White & Black Specs	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	1160S-30-06				
				Wall	Drywall Joint Compound	10m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-30-04 1160S-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-30-04 1160S-30-04	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
D/C - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	5	528	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	528A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	5	528B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	5	528C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	529	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Vinyl Baseboard with Yellow Adhesive	7 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Uninsulated Electrical		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	5	530	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Vinyl Baseboard with Yellow Adhesive	7 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Uninsulated Electrical		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	5	531	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	531A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	5	531B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	5	531C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	532	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	532A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	5	S32B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	S32C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	S33	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	S33A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	5	S33B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	S33C	Floor	VSF 1 - Grey with White & Black Specs	5 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	S34	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
				Wall	Drywall Joint Compound	28 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	S34A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	28 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	S34B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	28 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	S34C	Floor	VSF 1 - Grey with White & Black Specs	5 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	S35	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
				Wall	Drywall Joint Compound	28 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	S35A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	28 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	5	S35B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	S35C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	S36	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	S36A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	S36B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	S36C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	S37	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	S37A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	5	537B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	537C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	538	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	538A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	538B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	538C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	539	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	539A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	5	S39B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	S39C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	S40	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	S40A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	S40B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	S40C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	S41	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	S41A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Asbestos-Containing Material Record 2023

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	5	541B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	541C	Floor	VSF 1 - Grey with White & Black Specs	5 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	542	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
				Wall	Drywall Joint Compound	28 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	542A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	542B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	542C	Floor	VSF 1 - Grey with White & Black Specs	5 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	543	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
				Wall	Drywall Joint Compound	28 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	543A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11 m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	5	S43B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	5	S43C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	5	S44	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					On wall & columns.			
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	5	S45	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	198m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Vinyl Baseboard with Yellow Adhesive	86 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	ACT 1, 60cm x 120cm - Small Pinholes & Fissures	68m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03				
					Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Mech	Fibreglass with Foil Covering on Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	5	S46	Floor	VFT 3, 30cm x 30cm - Grey with Grey & White Smears	78m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 3	GEC-30LE-SA-04	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
				Wall	Drywall Joint Compound	58m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	21m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
					Drywall Joint Compound	21m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					ACT 1, 60cm x 120cm - Small Pinholes & Fissures	3m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03				
					Poured Concrete Deck							N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Mech	Fibreglass with Foil/Plastic Covering on Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	5	S47	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					On wall & columns.			
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	5	S48	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	198m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Vinyl Baseboard with Yellow Adhesive	86 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	ACT 1, 60cm x 120cm - Small Pinholes & Fissures	68m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03				
					Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	5	549	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	198m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04				
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	86 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	ACT 1, 60cm x 120cm - Small Pinholes & Fissures	68m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	116OS-3O-03				
					Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	5	550	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					On wall & columns.		
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	4	401	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	4	402	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04	No access above solid ceiling.			
30	LE	4	402A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	116OS-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	4	402B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	116OS-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	4	402C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	116OS-3O-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04	No access above solid ceiling.			
30	LE	4	403	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	4	403A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	403B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	403C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	403D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	403E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	403F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	404	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	404A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	4	404B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	404C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	404D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	404E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	404F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	405	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	405A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	405B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	4	405C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	405D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	405E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	405F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	406	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	406A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	406B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	406C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	4	406D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	406E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	406F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	407	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	19m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	407A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	407B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	407C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	407D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	4	407E	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	4	407F	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	4	408	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	4	408A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	4	408B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	4	408C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	4	408D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	4	408E	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	4	408F	Floor	VSF 1 - Grey with White & Black Specs	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	116OS-30-06			
				Wall	Drywall Joint Compound	10m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04	No access above solid ceiling.		
30	LE	4	409	Floor	VFT 1, 30cm x 30cm - Black with White Fleck	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 1	GEC-30LE-SA-02	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	15m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04			
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	6 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	4	410	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	47m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04			
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	27 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	ACT 1, 60cm x 120cm - Small Pinholes & Fissures	43m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	116OS-30-03			
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	4	411	Floor	VFT 1, 30cm x 30cm - Black with White Fleck	6m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 1	GEC-30LE-SA-02	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	17m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04			
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	7 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	4	412	Floor	VFT 1, 30cm x 30cm - Black with White Fleck	6m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 1	GEC-30LE-SA-02	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	17m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04			
					Vinyl Baseboard with Yellow Adhesive	7 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	4	413	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	4	413A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	413B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	413C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	413D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	413E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	413F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	414	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	414A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	4	414B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	414C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	414D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	414E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	414F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	415	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	415A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	415B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	4	415C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	415D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	415E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	415F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	416	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	416A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	416B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	416C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	4	416D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	416E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	416F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	417	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	417A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	417B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	417C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	417D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	4	417E	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	4	417F	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	4	418	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	4	418A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	4	418B	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	4	419	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	4	419A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	4	419B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	4	419C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	4	420	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	7 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Electrical		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	4	421	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	7 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Electrical		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	4	422	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	4	422A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	4	422B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	4	422C	Floor	Ceramic Tile		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	4	423	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	4	423A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	4	423B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	4	423C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	4	423D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
				Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	4	423E	Wall	Drywall Joint Compound	20m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			PSC	11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	4	423F	Floor	VSF 1 - Grey with White & Black Specs	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	4	424	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	4	424A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	4	424B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	4	424C	Floor	VSF 1 - Grey with White & Black Specs	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	4	425	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	4	425A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	4	425B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	4	425C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	4	425D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	4	425E	Floor	VSF 1 - Grey with White & Black Specs	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	4	425F	Floor	VSF 1 - Grey with White & Black Specs	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	4	426	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04	No access above solid ceiling.			
30	LE	4	426A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	4	426B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	4	426C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	4	426D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	4	426E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	1160S-3O-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04	No access above solid ceiling.			
30	LE	4	426F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	1160S-3O-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04	No access above solid ceiling.			
30	LE	4	427	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	4	427A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	427B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	427C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	427D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	427E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	427F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	428	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	428A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	4	428B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	428C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	428D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	4	428E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	428F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	4	429	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					On wall & columns.			
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	4	430	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	198m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Vinyl Baseboard with Yellow Adhesive	86 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	ACT 1, 60cm x 120cm - Small Pinholes & Fissures	68m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03				
					Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Mech	Fibreglass with Foil Covering on Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
D/C - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	4	431	Floor	VFT 3, 30cm x 30cm - Grey with Grey & White Smears	78m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A		4th Floor Fig	VFT 3	GEC-3OLE-5A-04A/B/C	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	58m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-5A-05			
				Ceiling	Textured Ceiling Finish	21m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-5A-01	No access above solid ceiling.		
					Drywall Joint Compound	21m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					ACT 1, 60cm x 120cm - Small Pinholes & Fissures	3m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03			
					Poured Concrete Deck							N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Fibreglass with Foil/Plastic Covering on Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	4	432	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					On wall & columns.		
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	4	433	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	198m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	86 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-5A-05			
				Ceiling	ACT 1, 60cm x 120cm - Small Pinholes & Fissures	68m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03			
					Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	4	434	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	198m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	86 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-5A-05			
				Ceiling	ACT 1, 60cm x 120cm - Small Pinholes & Fissures	68m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03			
					Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	4	435	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					On wall & columns.		
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	3	301	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	3	302	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-5A-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-5A-05			
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	3	302A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	3	302B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	3	302C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	3	303	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	3	303A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	3	303B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	3	303C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	3	303D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	3	303E	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	3	303F	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	3	304	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	3	304A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	304B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	304C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	304D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	304E	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	3	304F	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	3	305	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	3	305A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	305B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	305C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	305D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	305E	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	3	305F	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	3	306	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04	No access above solid ceiling.			
30	LE	3	306A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	3	306B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	3	306C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	3	306D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	3	306E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	1160S-3O-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04	No access above solid ceiling.			
30	LE	3	306F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	1160S-3O-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04	No access above solid ceiling.			
30	LE	3	307	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	19m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-3O-04 1160S-3O-04	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	3	307A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	3	307B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	3	307C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	3	307D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	3	307E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	3	307F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	3	308	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	3	308A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	3	308B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	3	308C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	3	308D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	3	308E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	3	308F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	3	309	Floor	VFT 1, 30cm x 30cm - Black with White Fleck	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 1	GEC-30LE-SA-02	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
				Wall	Drywall Joint Compound	15m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Vinyl Baseboard with Yellow Adhesive	6 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	3	310	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	47m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Vinyl Baseboard with Yellow Adhesive	27 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	ACT 1, 60cm x 120cm - Small Pinholes & Fissures	43m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03				
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
D/C - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	3	311	Floor	VFT 1, 30cm x 30cm - Black with White Fleck	6m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 1	GEC-3OLE-SA-02	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	17m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-3D-04 11605-3D-04			
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	7 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	3	312	Floor	VFT 1, 30cm x 30cm - Black with White Fleck	6m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 1	GEC-3OLE-SA-02	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	17m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-3D-04 11605-3D-04			
					Vinyl Baseboard with Yellow Adhesive	7 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	3	313	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-3D-04 11605-3D-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Drywall Joint Compound	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-3D-04 11605-3D-04	No access above solid ceiling.		
30	LE	3	313A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-3D-04 11605-3D-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-3D-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	3	313B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-3D-04 11605-3D-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-3D-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	3	313C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-3D-04 11605-3D-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-3D-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	3	313D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-3D-04 11605-3D-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-3D-01 GEC-3OLE-SA-01	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	3	313E	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	3	413F	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	3	314	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	3	314A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	314B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	314C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	314D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	314E	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	3	314F	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	3	315	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	3	315A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	315B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	315C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	315D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	315E	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	3	315F	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	3	316	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04	No access above solid ceiling.			
30	LE	3	316A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	116OS-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	3	316B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	116OS-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	3	316C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	116OS-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	3	316D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	116OS-3O-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	3	316E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	116OS-3O-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04	No access above solid ceiling.			
30	LE	3	316F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	116OS-3O-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04	No access above solid ceiling.			
30	LE	3	317	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-3O-04 116OS-3O-04	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
D/C - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont. **System**
P/C-Parging cement Mech = Mechanical
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	3	317A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	3	317B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	3	317C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	3	317D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	3	317E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	3	317F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	3	318	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	3	318A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	3	318B	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	3	319	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	3	319A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	3	319B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	3	319C	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
				Ceiling	Drywall Joint Compound	3m	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			PPE	11605-30-04	No access above solid ceiling.			
30	LE	3	320	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Vinyl Baseboard with Yellow Adhesive	7 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Uninsulated Electrical		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	3	321	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Vinyl Baseboard with Yellow Adhesive	7 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Uninsulated Electrical		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	3	322	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	3	322A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Asbestos-Containing Material Record 2023

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	3	322B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	3	322C	Floor	Ceramic Tile		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	3	323	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	3	323A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	3	323B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	3	323C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	3	323D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	3	323E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	3	323F	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	3	324	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	3	324A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	324B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	324C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	3	325	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	3	325A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	325B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	3	325C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	325D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	325E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	3	325F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	3	326	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	3	326A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	326B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	326C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	3	326D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	326E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	3	326F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	3	327	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	3	327A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	327B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	327C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	327D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
D/C - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	3	327E	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	3	327F	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	3	328	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	3	328A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	328B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	328C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	328D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	3	328E	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	3	328F	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	3	329	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					On wall & columns.		
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	3	330	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$198m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	86 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	ACT 1, 60cm x 120cm - Small Pinholes & Fissures	$68m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03			
					Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Fibreglass with Foil Covering on Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	3	331	Floor	VFT 3, 30cm x 30cm - Grey with Grey & White Smears	$78m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 3	GEC-30LE-SA-04	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$58m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$21m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
					Drywall Joint Compound	$21m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					ACT 1, 60cm x 120cm - Small Pinholes & Fissures	$3m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03			
					Poured Concrete Deck							N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Fibreglass with Foil/Plastic Covering on Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	3	332	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					On wall & columns.		
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	3	333	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$198m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	86 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	ACT 1, 60cm x 120cm - Small Pinholes & Fissures	$68m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03			
					Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	3	334	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$198m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	86 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	ACT 1, 60cm x 120cm - Small Pinholes & Fissures	$68m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03			
					Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	3	335	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					On wall & columns.		
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	2	201	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	2	202	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	202A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	2	202B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	2	202C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	203	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	203A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	2	203B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	2	203C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	2	203D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	2	203E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	203F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	204	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	204A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	2	204B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	2	204C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	204D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	204E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	204F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	205	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	205A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	205B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	205C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	2	205D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	205E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	205F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	206	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	206A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	206B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	206C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	206D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	2	206E	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	2	206F	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	2	207	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$19m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	2	207A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	207B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	207C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	207D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	207E	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	2	207F	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	2	208	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	2	208A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	208B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	208C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	208D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	208E	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	2	208F	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
D/C - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	2	209	Floor	VFT 1, 30cm x 30cm - Black with White Fleck	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 1	GEC-30LE-SA-02	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	15m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	6 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	2	210	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	47m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	27 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	ACT 1, 60cm x 120cm - Small Pinholes & Fissures	43m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03			
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	2	211	Floor	VFT 1, 30cm x 30cm - Black with White Fleck	6m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 1	GEC-30LE-SA-02	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	17m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	7 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	2	212	Floor	VFT 1, 30cm x 30cm - Black with White Fleck	6m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 1	GEC-30LE-SA-02	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	17m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	7 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	2	213	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	2	213A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	2	213B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	213C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	213D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	213E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	213F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	214	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	214A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	214B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	2	214C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	214D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	214E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	214F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	215	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	215A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	215B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	215C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	2	215D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	215E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	215F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	216	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	216A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	216B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	216C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	216D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	2	216E	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	2	216F	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	2	217	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	2	217A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	217B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	217C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	217D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	217E	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	2	217F	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	116OS-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04	No access above solid ceiling.		
30	LE	2	218	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04	No access above solid ceiling.		
30	LE	2	218A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	116OS-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	218B	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	116OS-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04	No access above solid ceiling.		
30	LE	2	219	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A		2nd Floor Fig	VFT 2	GEC-30LE-SA-03A/B/C	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04	No access above solid ceiling.		
30	LE	2	219A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	116OS-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	219B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	116OS-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	219C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	116OS-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	116OS-30-04 116OS-30-04	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	2	220	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	7 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Electrical		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	2	221	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	7 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Electrical		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	2	222	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	2	222A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	222B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	222C	Floor	Ceramic Tile		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	2	223	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	2	223A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	223B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	223C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	223D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	223E	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
				Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	2	223F	Wall	Drywall Joint Compound	20m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			PIC	11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	2	224	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	2	224A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	224B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	224C	Floor	VSF 1 - Grey with White & Black Specs	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	2	225	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	2	225A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	225B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	225C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	225D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	2	225E	Floor	VSF 1 - Grey with White & Black Specs	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	2	225F	Floor	VSF 1 - Grey with White & Black Specs	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	2	226	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-301E-SA-05			
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	2	226A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	226B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A		2nd Floor Fig	Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01A	No access above solid ceiling.			
30	LE	2	226C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	226D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	226E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	226F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	227	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	227A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	2	227B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	227C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	227D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	227E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	227F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	228	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	228A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	228B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	2	228C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	228D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	2	228E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	228F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	2	229	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					On wall & columns.			
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Mech	Fibreglass with Canvas/Paper Covering on Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	2	230	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	198m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Vinyl Baseboard with Yellow Adhesive	86 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	ACT 1, 60cm x 120cm - Small Pinholes & Fissures	68m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03				
					Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Mech	Fibreglass with Foil Covering on Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	2	231	Floor	VFT 3, 30cm x 30cm - Grey with Grey & White Smears	78m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 3	GEC-30LE-SA-04	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
				Wall	Drywall Joint Compound	58m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	21m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A		2nd Floor Fig	Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01R	No access above solid ceiling.			
					Drywall Joint Compound	21m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					ACT 1, 60cm x 120cm - Small Pinholes & Fissures	3m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03				
					Poured Concrete Deck							N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Mech	Fibreglass with Foil/Plastic Covering on Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
D/C - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	2	231B	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	4m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Vent		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	2	232	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					On wall & columns.		
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	2	233	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	198m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	86 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	ACT 1, 60cm x 120cm - Small Pinholes & Fissures	68m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03				
					Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	2	234	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	198m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	86 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	ACT 1, 60cm x 120cm - Small Pinholes & Fissures	68m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03				
					Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	2	235	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					On wall & columns.		
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	1	101	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					On walls, columns and beams.		
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Fibreglass with Canvas/Plastic or Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	1	102	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Fibreglass with Canvas/Plastic Covering on Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	1	103									N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					No access to this location.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	1	104	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-3OLE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-30-04 1160S-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-30-04 1160S-30-04	No access above solid ceiling.			
30	LE	1	104A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-30-04 1160S-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-30-01 GEC-3OLE-SA-01	No access above solid ceiling.			
				Mech	Fibreglass with Paper Covering on Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	1	104B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-30-04 1160S-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-30-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	1	104C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-30-04 1160S-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-30-01 GEC-3OLE-SA-01	No access above solid ceiling.			
30	LE	1	104D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-30-04 1160S-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	1160S-30-01 GEC-3OLE-SA-01	No access above solid ceiling.			
				Mech	Fibreglass with Paper Covering on Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	1	104E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	1160S-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-30-04 1160S-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	1160S-30-04 1160S-30-04	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
D/C - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	1	104F	Floor	VSF 1 - Grey with White & Black Specs	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	1	105	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	1	105A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
				Mech	Fibreglass with Paper Covering on Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	1	105B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	1	105C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	1	105D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
				Mech	Fibreglass with Paper Covering on Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	1	105E	Floor	VSF 1 - Grey with White & Black Specs	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	1	105F	Floor	VSF 1 - Grey with White & Black Specs	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	1	106	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	1	106A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
				Mech	Fibreglass with Paper Covering on Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	1	106B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	1	106C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
D/C - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
30	LE	1	106D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-3OLE-SA-01	No access above solid ceiling.		
				Mech	Fibreglass with Paper Covering on Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	1	106E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	1	106F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	1	107	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	1	107A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
				Mech	Fibreglass with Paper Covering on Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	1	107B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	1	107C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	1	107D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
				Mech	Fibreglass with Paper Covering on Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	1	107E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	1	107F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	1	108	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	1	108A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
				Mech	Fibreglass with Paper Covering on Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	1	108B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	1	108C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	1	108D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Cell Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
				Mech	Fibreglass with Paper Covering on Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	1	108E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	1	108F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
D/C - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	1	109	Floor	VFT 1, 30cm x 30cm - Black with White Fleck	5m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 1	GEC-30LE-SA-02	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	15m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	6 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	1	110	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	47m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	27 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	ACT 1, 60cm x 120cm - Small Pinholes & Fissures	43m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03			
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Fibreglass with Paper Covering or Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	1	111	Floor	VFT 1, 30cm x 30cm - Black with White Fleck	6m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 1	GEC-30LE-SA-02	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	17m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	7 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	1	112	Floor	VFT 1, 30cm x 30cm - Black with White Fleck	6m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 1	GEC-30LE-SA-02	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	17m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	7 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	1	113	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	1	113A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	11m²	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
				Mech	Fibreglass with Paper Covering on Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							

Carleton UNIVERSITY

Asbestos-Containing Material Record 2023

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	1	113B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	1	113C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
30	LE	1	113D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
				Mech	Fibreglass with Paper Covering on Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	1	113E	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	1	113F	Floor	VSF 1 - Grey with White & Black Specs	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06				
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	1	114	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.			
				Wall	Drywall Joint Compound	28m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	1	114A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	30m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	14 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	15m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A		1st Floor Fig	Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01C	No access above solid ceiling.			
				Mech	Fibreglass with Paper Covering on Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	1	114B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	30m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	14 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Textured Ceiling Finish	15m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.			
				Mech	Fibreglass with Paper Covering on Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	1	114C	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	1	115	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
					Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	1	115A	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	1	115B	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	1	115C	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	1	115D	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	12 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Textured Ceiling Finish	$11m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-SA-01	No access above solid ceiling.		
30	LE	1	115E	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	1	115F	Floor	VSF 1 - Grey with White & Black Specs	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VSF 1	11605-30-06			
				Wall	Drywall Joint Compound	$10m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	3 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	Drywall Joint Compound	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
D/C - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	1	116	Floor	VFT 1, 30cm x 30cm - Black with White Fleck	50m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 1	GEC-30LE-SA-02	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	30m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	28 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	ACT 1, 60cm x 120cm - Small Pinholes & Fissures	50m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03			
					Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Fibreglass with Plastic Covering or Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Fibreglass with Paper Covering on Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	1	117	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	16m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Fibreglass with Paper/Plastic Covering or Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	1	118	Floor	VFT 1, 30cm x 30cm - Black with White Fleck	64m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 1	GEC-30LE-SA-02	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	79m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Vinyl Baseboard with Yellow Adhesive	33 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05			
				Ceiling	ACT 1, 60cm x 120cm - Small Pinholes & Fissures	64m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03			
					Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Fibreglass with Plastic Covering or Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Fibreglass with Paper Covering on Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	1	119	Floor	Ceramic Tile		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	10m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04			
					Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	1	120	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Fiberglass with Foil Covering or Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Fibreglass with Paper Covering or Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	1	121	Floor	Ceramic Tile		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Ceramic Tile		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Drywall Joint Compound	15m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	1	122	Floor	Ceramic Tile		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Ceramic Tile		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Drywall Joint Compound	15m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04	No access above solid ceiling.		
30	LE	1	123									N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					No access to this location.		

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	1	124	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	60m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	38 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	ACT 1, 60cm x 60cm - Small Pinholes & Fissures	64m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03				
					Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Mech	Fibreglass with Plastic Covering or Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Fibreglass with Paper Covering or Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	1	125	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	1	126	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	11m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	1	127	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	1	128	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	15m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	5 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	ACT 2, 60cm x 120cm - Small Pinholes with a Textured Finish	24m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 2	11605-30-07				
					Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Mech	Fibreglass with Plastic Covering or Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Fibreglass with Paper Covering or Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	1	129	Floor	VFT 2, 30cm x 30cm - Beige with Beige Flecks	8m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			VFT 2	GEC-30LE-SA-03	Floor tile and floor tile mastic/adhesive analyzed as a composite sample. No asbestos was detected in the samples submitted.		
				Wall	Drywall Joint Compound	14m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04				
					Vinyl Baseboard with Yellow Adhesive	4 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-30LE-SA-05				
				Ceiling	Drywall Joint Compound	8m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	No access above solid ceiling.			
30	LE	1	130	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound (bulkhead)	2m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04	Bulkhead			
					Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Ceiling	ACT 1, 60cm x 120cm - Small Pinholes & Fissures	5m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03				
					Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Mech	Fibreglass with Paper Covering or Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Uninsulated Electrical		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
30	LE	1	131	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								
					Fibreglass with Paper Covering or Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A								

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
D/C - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	1	132	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					On wall & column.		
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Pump		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Tank		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Fibreglass with Canvas Covering or Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	1	133									N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					No access to this location.		
30	LE	1	134	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					On wall & column.		
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Fibreglass with Canvas Covering on Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Fibreglass with Canvas Covering or Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	1	135	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					On wall & column.		
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Fibreglass with Canvas Covering on Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Fibreglass with Canvas Covering or Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	1	136	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					On wall & columns.		
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Fibreglass with Canvas/Paper Covering on Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	1	137	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					On wall & column.		
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Fibreglass with Canvas Covering on Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Fibreglass with Canvas Covering or Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	1	138	Floor	Ceramic Tile		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	$28m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04				
				Ceiling	Textured Ceiling Finish	$20m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Tex Ceil Fin	11605-30-01 GEC-30LE-5A-01	No access above solid ceiling.			
					Drywall Joint Compound	$20m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			D/C	11605-30-04 11605-30-04				
					ACT 2, 60cm x 120cm - Small Pinholes with a Textured Finish	$5m^2$	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 2	11605-30-07				
					Poured Concrete Deck							N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Fibreglass with Foil/Plastic Covering on Duct		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	1	139	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					On wall & columns.		
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Fibreglass with Canvas/Plastic Covering on Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	1	140	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					On wall & columns.		
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							

Carleton UNIVERSITY

Material
A/C-Aircell
A/S-Antisweat
B/b - Baseboard
CP-Caposite
DJC - Drywall Joint Compound
F/G-Fiberglass
LP-Incandescent light paper
MB-Magnesia block

Material cont.
P/C-Parging cement
PL-Plaster
SFP-Sprayed fireproofing
TB-Transite board
TF-Texture finish
TP-Troweled fireproofing
VFT-Vinyl floor tile
VSF-Vinyl sheet flooring

System
Mech = Mechanical

Conditions
Good
Fair
Poor

Units of Measure
ea = each
m^2 = square metre
LM = Linear Metre
cm = Centimetre

Asbestos Type
CH = Chrysotile
CR = Crocidolite
AM = Amosite

Risk Rating Scoring
Friability: Non ACM (0), Non Friable (1), Friable (2)
Condition: Good (0), Fair (1), Poor (2)
Accessibility: Inaccessible (1), Maintenance (2), accessible (3)
Type: Chrysotile (1), Non Chrysotile (2)
Composition: fraction of asbestos in ACM
Notes: (1) when there is more than one type of asbestos, the highest score is applied
(2) when the ACM asbestos percent composition is a range, the highest percentage is applied
(3) When more than one score may apply to any paramter, the higher is always applied

Status Ratings
Abate
Enclose
Encapsulate
Manage in Place
Repair or Remove
Repair
Remove

Asbestos-Containing Material Record 2023

Building #	Building	Floor	Location	System	Material	Quantity	ACM				Friable		Condition						Accessibility		Risk Rating			Status	Sample Location Reference	Photo Log	Laboratory Reference	Notes	2023 Survey Notes	Abatement Date
							Yes / No	Rating	Score	Type & %	Yes/No	Score	Good	Score	Fair	Score	Poor	Score	Rating	Score	Good	Fair	Poor							
30	LE	1	141	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	198m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	86 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	ACT 1, 60cm x 120cm - Small Pinholes & Fissures	68m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03			
					Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	1	142	Floor	Carpet		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Drywall Joint Compound	198m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			DJC	11605-30-04 11605-30-04			
					Poured Concrete Columns		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
					Vinyl Baseboard with Yellow Adhesive	86 LM	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			Vinyl B/B	GEC-3OLE-SA-05			
				Ceiling	ACT 1, 60cm x 120cm - Small Pinholes & Fissures	68m^2	No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A			ACT 1	11605-30-03			
					Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Fibreglass with Paper/Canvas/Plastic Covering on Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
30	LE	1	143	Floor	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Wall	Poured Concrete		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A					On wall & columns.		
					Concrete Block		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Ceiling	Poured Concrete Deck		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							
				Mech	Uninsulated Piping		No					N/A		N/A		N/A		N/A	N/A		N/A	N/A	N/A							